


Dedicated Ultra-Aire Return to A/C Return

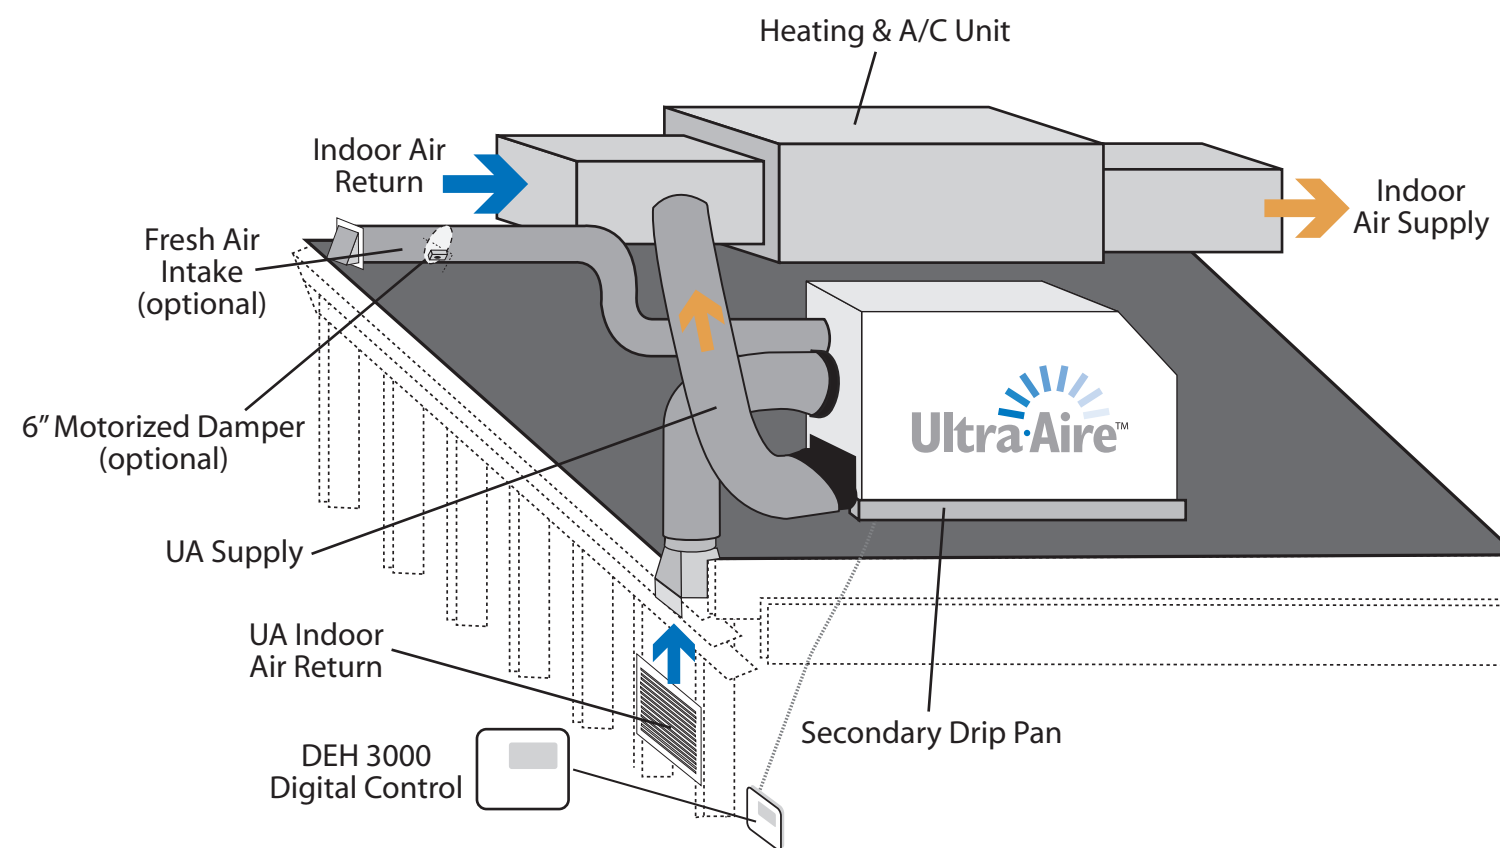

- Dehumidifier supply air will typically take the path of least resistance and travel back through the HVAC return unless the HVAC fan is on. This is acceptable as long as it is a fully ducted return. In a central return system, the AC fan must run when the dehumidifier is running.
- DEH 3000 should be centrally located.